OP857-V01

1. PRODUCT PROFILE



Figure 1.1 : Front view

2. DESCRIPTION

- EXP FLEX 2M V3 is an expansion module for use in conjunction with any PLCs (with RS485 Master Communication)
- Use to enhance I/O Configuration
- Any Flexys I/O card can be configured (one per device)
- Upto 7 numbers of EXP FLEX 2M V3 devices can be connected to a Master PLC
- Two baud rate selections - 19200 & 115200
- RS485 Slave IN & OUT separate terminals (for easy loop & wiring)
- 4 LED indicators
- Four way DIP switch for Slave ID & Baud rate selection

3. ELECTRICAL SPECIFICATIONS

Supply Voltage	24VDC ±10 %
Power Consumption	2.5 W
Reverse polarity protection	Yes
Isolation	No (between power circuit and communication circuit)

FUNCTIONAL SPECIFICATIONS

Response Time	100 ms to 2 sec based on number of EXP FLEX 2M V3 devices configured + I/O card type

DIP SWITCH SELECTION

Slave ID	DIP SWITCH			
	1	2	3	4
NA	X	OFF	OFF	OFF
1		OFF	OFF	ON
2		OFF	ON	OFF
3		OFF	ON	ON
4		ON	OFF	OFF
5		ON	OFF	ON
6		ON	ON	OFF
7		ON	ON	ON
Baud Rate				
19200	OFF	X	X	X
115200	ON	X	X	X

LED Display

LED Name	LED COLOR	INDICATION
Power LED (PWR)	Green	Always ON when device is powered
Receive LED (Rx)	Green	Blinks when EXP FLEX 2M V3 device receives RS485 command from master
Transmit LED (Tx)	Red	Blinks when EXP FLEX 2M V3 device transmits RS485 response to master
Error LED (Err)	Red	ON – when I/O card is not connected
		Flashing – 2 sec ON, 0.3 sec OFF – when I/O card is mismatched *1
		Flashing – 0.3 sec ON, 0.3 sec OFF – when No Master communication is received for 6 secs
		OFF – successful operation

*1 : When configured I/O card in SELPRO software is different from connected I/O card in EXP FLEX 2M V3

COMMUNICATION

Communication Port	RS485 slave
Communication Protocols	Modbus
Baud Rate	19200 and 115200 (User configurable) (Deafult = 19200)
Fixed settings	Parity = None(N), Stop bits = 2, Data length = 8

MECHANICAL SPECIFICATIONS

Dimension (W x H x D)	35 mm x 90 mm x 88 mm
Weight (g)	87.1
Mounting	Din Rail Mounting

ENVIRONMENTAL CONDITIONS

Operating Temperature	0° to 55°C
Storage Temperature	-20° to 70°C
Humidity (non-condensing)	10% to 95% RH


SOFTWARE DETAILS

R : Read only

- Configure EXP FLEX 2M V3 device for a given Controller using FLEX 2M COMM utility software.
  For details of the software and configuration method, please refer to the software manual.
- Auto generated registers in FLEX 2M COMM utility software as shown below :
  Example : FL-SC-RO08 card is configured in EXP FLEX 2M V3 device via FLEX 2M COMM utility with Slave ID=1.

Variable Name	Var. Type	Modbus Address	Description
MOD_ID	VAR OUT	30000	Module ID
HW_VerNo	VAR OUT	30001	H/W Version No
SW_VerNo	VAR OUT	30002	S/W Version No
SlotStatus	VAR OUT	30003	Slot Status S=0 : refers to Slot empty S=15 : refers to Slot ready S-=Other than 0 and 15 : Contact Vendor
SlotErrorCntr	VAR OUT	30004	Slot Error Counter
RO8_OUT0	VAR OUT	0	Relay Output0
RO8_OUT1	VAR OUT	1	Relay Output1
RO8_OUT2	VAR OUT	2	Relay Output2
RO8_OUT3	VAR OUT	3	Relay Output3
RO8_OUT4	VAR OUT	4	Relay Output4
RO8_OUT5	VAR OUT	5	Relay Output5
RO8_OUT6	VAR OUT	6	Relay Output6
RO8_OUT7	VAR OUT	7	Relay Output7

4. INSTALLATION PROCEDURE

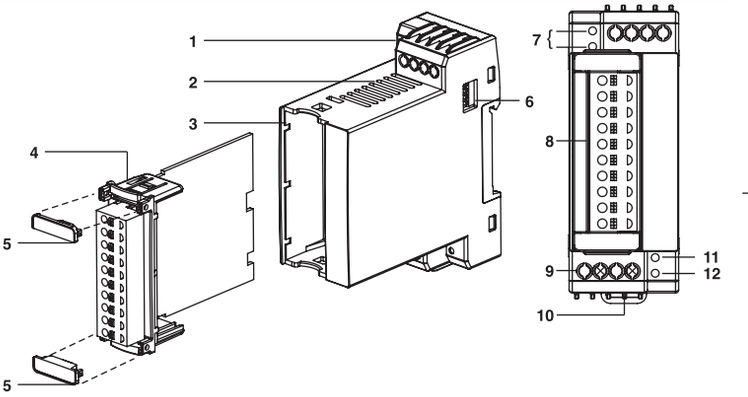


1	Communication Ports	7	Communication Status Indicator
2	Ventilation grills	8	Spring type pluggable terminal block (5.08 mm pitch)
3	Slot for FL-SC-XX card	9	Power Supply Connector
4	Fascia	10	Clamp
5	Card lock	11	Power Indicator
6	DIP Switch Selector	12	Error Indicator

NOTE : 1) When installing, insert the card into the slot until you hear an audible click.
2) Ensure that I/O card installed is same as the one defined in Ladder Program.
3) Place Card lock to prevent movement of card from base unit.
Follow these steps to remove the I/O card from base unit :
1. Remove both the Card locks
2. Press at the top and bottom part of fascia and pull the card from base unit.

⚠ DANGER

1. Do not install in areas with excessive or conductive dust, corrosive or flammable gas, moisture or rain, excessive heat,.
   regular impact shocks or excessive vibration.


5. DIN RAIL MOUNTING / DIMENSION

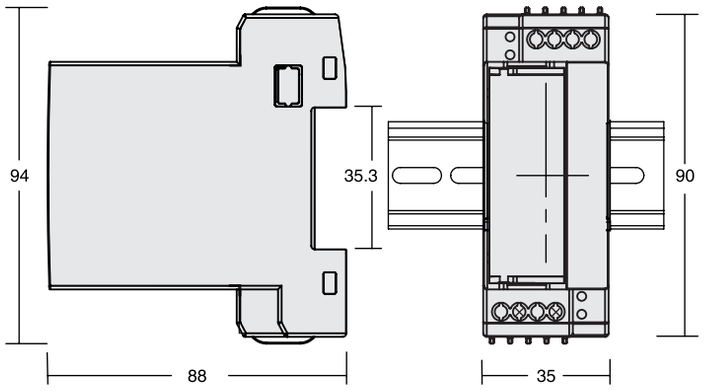

Dimensions in mm

- Install the device in an enclosure with sufficient space around it to allow heat dissipation,
- Be sure to use DIN rail clamp to stop movement of the device.
- The clamp is at the bottom of the device. To secure the device to DIN rail, Push down the device until it click.
- To remove the device, pull the clamp down with a flat screwdriver and gently pull the device up to remove from DIN rail.

6. WIRING DETAILS

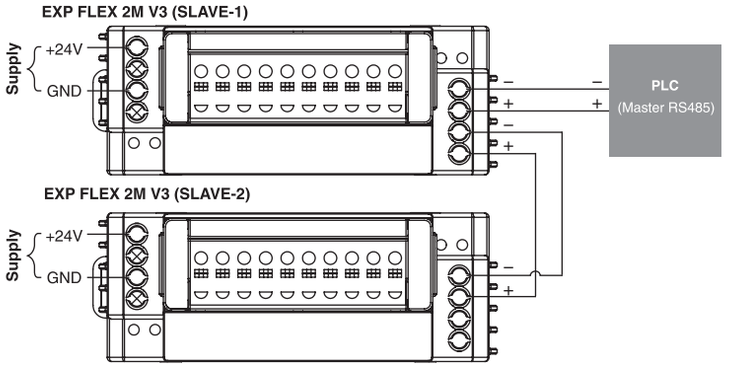

⚠ CAUTION

- In situations of high transmission speed, long distance or high noise, the high quality twisted pair cable should be used. However in situations of low transmission speed and low noise, PVC twisted pair cable will be compatible.
- The laying of cables on ventilation grills is not permitted. This would considerably impede the heat dissipation of the devices.

⚠ WARNING

- Analog I/O wiring length to be restricted up to 3 m.
- The power supply connection cable must have a cross section of 1sq.mm or greater and insulation capacity of at least 1.5 kV.

WIRING INSTRUCTIONS

- In PLC control system, many devices are controlled at the same time and actions of any device could influence each other, i.e. breakdown of any device may cause the breakdown of the entire auto-control system and danger. Therefore, we suggest you wire a noise protection circuit at the power supply input terminal.
- Use the shortest possible wire length.
- Use wire trays for routing where possible.
- To minimize voltage drops when wires must run a long distance, consider using multiple wires for the return line.
- Avoid running lower voltage wiring near higher voltage wiring.
- Avoid running input wiring close to output wiring where possible.
- Avoid running DC wiring in close proximity to AC wiring where possible.
- Avoid creating sharp bends in the wires.
- The output terminals should not be loaded more than the values/range specified by the manufacturer.
- Always use a continuous length of wire. Do not splice wires to attain a needed length.

7. SAFETY SUMMARY

⚠ DANGER

Indicates that death or severe personal injury will result if proper precautions are not taken.

⚠ WARNING

Indicates that death or severe personal injury may result if proper precautions are not taken.

⚠ CAUTION

With a safety alert symbol, indicates that minor personal injury can result if proper precautions are not taken.

NOTE :

Indicates that an unintended result or situation can occur if the relevant information is not taken into account.

SAFETY PRECAUTIONS

- This manual is meant for person involved in wiring, installation and operation of the equipment.
- Safety related conditions, symbols & instructions that appear in this operating manual or on the equipment must be strictly followed to ensure operator's and instrument's safety.
- Commissioning is absolutely prohibited until it has been completely ensured that the machine, in which the components described here are to be installed, is in full compliance with the provisions of the EC Machinery Directive.

⚠ DANGER

- Failure to comply with appropriate safety guidelines can result in severe personal injury or property damage. Always exercise proper caution when working with electrical equipment.
- Improper grounding may result in communication error, electric shock or fire.

⚠ WARNING

- Read complete instructions prior to installation and operation of the controller/card
- Proper transport, storage, installation, assembly, commissioning, operation and maintenance are required to ensure that product operate safely and without any problem.

⚠ CAUTION

- In addition to the danger and warning information provided in the manual, the applicable national, local and system specific regulations and requirements must be taken into account.
- If product and components from other manufacturers are used, these must be recommended or approved by SELEC Controls Pvt Ltd.

EMC GUIDELINES

- The permissible ambient conditions must be complied
- Power supply lines length to be maintained within 10m.

MAINTENANCE

- To avoid blockage of ventilation grills, clean the equipment regularly using a soft cloth.
- Do not use Isopropyl Alcohol or any other organic solvents for cleaning.
- Conductors must not come in contact with the internal circuitry of the controller or else it may lead to a safety hazard that may cause electrical shock to operator.

DISCLAIMER LIABILITY

We have reviewed the contents of this publication to ensure consistency with the hardware and software described. Since variance cannot be precluded entirely, we cannot guarantee full consistency However the information in this publication is reviewed and any necessary corrections are included in subsequent editions.

? SERVICE DETAILS

This device contains no user serviceable parts and requires special equipment and specialized engineers for repair.
Please contact service center for repair on the following numbers :
Tel. No. : + 91-7498077172 ; **Email :** service@selec.com

NO WARRANTY ON UNIT DAMAGED DUE TO WRONG POWER SUPPLY.

(Specifications are subject to change, since development is a continuous process.)

Selec Controls Pvt. Ltd., India

Factory Address :
EL-27/1, Electronic Zone, TTC Industrial Area, MIDC, Mahape, Navi Mumbai - 400 710, INDIA.
Tel. No. : +91-22-4148 419/430 I Fax No. : +91-22-28471733
Toll free : 1800 227 353 (BSNL/MTNL Subscribers only)
Website : www.selec.com I Email : sales@selec.com